



## Enquiry Confirmation

LSBUD Ref: 11990220

Date of enquiry: 12/01/2018

Time of enquiry: 14:15

Enquirer			
Name	Mrs Trudi Phillips	Phone	01443 815050
Company	Caerphilly CBC	Mobile	Not Supplied
		Fax	Not Supplied
Address	Dyffryn House Ty Dyffryn Business Park Ystrad Mynach Hengoed Caerphilly CF82 7TW		
Email	phillt@caerphilly.gov.uk		
Notes	Please ensure your contact details are correct and up to date on the system in case the LSBUD Members need to contact you.		

Enquiry Details			
Scheme/Reference	Nant Cylla Gabian Baskets		
Enquiry type	Initial Enquiry	Work category	Watercourses/Canals/Drainage
Start date	23/07/2018	Work type	Bank Works
End date	01/09/2018	Site size	405 metres diameter
Searched location	XY= 314622, 194181 Easting/Northing	Work type buffer*	25 metres
Confirmed location	314622 194180		

\* The WORK TYPE BUFFER is a distance added to your search area based on the Work type you have chosen.



## Asset Owners

**Terms and Conditions.** Please note that this enquiry is subject always to our standard terms and conditions available at [www.linesearchbeforeudig.co.uk](http://www.linesearchbeforeudig.co.uk) ("Terms of Use") and the disclaimer at the end of this document. Please note that in the event of any conflict or ambiguity between the terms of this Enquiry Confirmation and the Terms of Use, the Terms of Use shall take precedence.

**Validity and search criteria.** The results of this enquiry are based on the confirmed information you entered and are valid only as at the date of the enquiry. It is your responsibility to ensure that the Enquiry Details are correct, and LineSearchbeforeUdig accepts no responsibility for any errors or omissions in the Enquiry Details or any consequences thereof. LSBUD Members update their asset information on a regular basis so you are advised to consider this when undertaking any works. It is your responsibility to choose the period of time after which you need to resubmit any enquiry but the maximum time (after which your enquiry will no longer be dealt with by the LSBUD Helpdesk and LSBUD Members) is 28 days. If any details of the enquiry change, particularly including, but not limited to, the location of the work, then a further enquiry must be made.

**Asset Owners & Responses.** Please note the enquiry results include the following:

1. "LSBUD Members" who are asset owners who have registered their assets on the LSBUD service.
2. "Non LSBUD Members" are asset owners who have not registered their assets on the LSBUD service but LSBUD is aware of their existence. Please note that there could be other asset owners within your search area.

Below are three lists of asset owners:

1. **LSBUD Members who have assets registered within your search area. ("Affected")**
  - a. **These LSBUD Members will either:**
    - i. **Ask for further information ("Email Additional Info" noted in status).** The additional information includes: Site contact name and number, Location plan, Detailed plan (minimum scale 1:2500), Cross sectional drawings (if available), Work Specification.
    - ii. **Respond directly to you ("Await Response").** In this response they may either send plans directly to you or ask for further information before being able to do so, particularly if any payments or authorisations are required.
2. **LSBUD Members who do not have assets registered within your search area. ("Not Affected")**
3. **Non LSBUD Members who may have assets within your search area.** Please note that this list is not exhaustive and all details are provided as a guide only. It is your responsibility to identify and consult with all asset owners before proceeding.

**National Grid.** Please note that the LSBUD service only contains information on National Grid's Gas above 7 bar asset, all National Grid Electricity Transmission assets and National Grid's Gas Distribution Limited above 2 bar asset.

For National Grid Gas Distribution Ltd below 2 bar asset information please go to [www.beforeyoudig.nationalgrid.com](http://www.beforeyoudig.nationalgrid.com)

**LSBUD Members who have assets registered on the LSBUD service within the vicinity of your search area.**

### List of affected LSBUD members

Asset Owner	Phone/Email	Emergency Only	Status
Western Power Distribution	08000963080	08006783105	Await response

**LSBUD Members who do not have assets registered on the LSBUD service within the vicinity of your search area. Please be aware that LSBUD Members make regular changes to their assets and this list may vary for new enquiries in the same area.**

### List of not affected LSBUD members

AWE Pipeline	Gamma	Premier Transmission Ltd (SNIP)
BOC Limited (A Member of the Linde Group)	Gateshead Energy Company	Prysmian Cables & Systems Ltd (c/o Western Link)
BP Exploration Operating Company Limited	Gigaclear PLC	Redundant Pipelines - LPDA
BPA	Humbly Grove Energy	RWEnpower (Little Barford and South Haven)
Carrington Gas Pipeline	IGas Energy	SABIC UK Petrochemicals
CATS Pipeline c/o Wood Group PSN	INEOS FPS Pipelines	Scottish Power Generation
Cemex	INEOS Manufacturing (Scotland and TSEP)	Seabank Power Ltd
Centrica Storage Ltd	INOVYN Enterprises Limited	SGN
CLH Pipeline System Ltd	Intergen (Coryton Energy or Spalding Energy)	Shell (St Fergus to Mossmorran)
Concept Solutions People Ltd	Mainline Pipelines Limited	Shell Pipelines
ConocoPhillips (UK) Ltd	Manchester Jetline Limited	SSE (Peterhead Power Station)
DIO (MOD Abandoned Pipelines)	Manx Cable Company	Total (Colnbrook & Colwick Pipelines)
E.ON UK CHP Limited	Marchwood Power Ltd (Gas Pipeline)	Total Finaline Pipelines
EirGrid	Melbourn Solar Limited	Transmission Capital
Electricity North West Limited	National Grid Gas (Above 7 bar), National Grid Gas Distribution Limited (Above 2 bar) and National Grid Electricity Transmission	UK Power Networks
ENI & Himor c/o Penspen Ltd	Northumbrian Water Group	Uniper UK Ltd
EnQuest NNS Limited	NPower CHP Pipelines	Vattenfall
EP Langage Limited	Oikos Storage Limited	Veolia ES SELCHP Limited
ESP Utilities Group	Ørsted	Westminster City Council
ESSAR	Perenco UK Limited (Purbeck Southampton Pipeline)	Wingas Storage UK Ltd
Esso Petroleum Company Limited	Petroineos	Zayo Group UK Ltd c/o JSM Group Ltd
Fulcrum Pipelines Limited	Phillips 66	

**The following Non-LSBUD Members may have assets in your search area. It is YOUR RESPONSIBILITY to contact them before proceeding. Please be aware this list is not exhaustive and it is your responsibility to identify and contact all asset owners within your search area.**

Non-LSBUD members (Asset owners not registered on LSBUD)			
Asset Owner	Preferred contact method	Phone	Status
BT	<a href="https://www.swns.bt.com/pls/mbe/welcome.home">https://www.swns.bt.com/pls/mbe/welcome.home</a>	08009173993	Not Notified
Caerphilly Council	<a href="mailto:parhab@caerphilly.gov.uk">parhab@caerphilly.gov.uk</a>	01495235372	Not Notified
CityFibre	<a href="mailto:asset.team@cityfibre.com">asset.team@cityfibre.com</a>	033 3150 7282	Not Notified
Colt	<a href="mailto:plantenquiries@catelecomuk.com">plantenquiries@catelecomuk.com</a>	01227768427	Not Notified
Dwr Cymru Welsh Water	<a href="mailto:ndcenquiries@dwrcymru.com">ndcenquiries@dwrcymru.com</a>	0800 917 2652	Not Notified
Energetics Electricity	<a href="mailto:plantenquiries@energetics-uk.com">plantenquiries@energetics-uk.com</a>	01698404646	Not Notified
ENGIE	<a href="mailto:nrswa@cofely-gdfsuez.com">nrswa@cofely-gdfsuez.com</a>	01293 549944	Not Notified
GTC	<a href="https://pe.gtc-uk.co.uk/PlantEnqMembership">https://pe.gtc-uk.co.uk/PlantEnqMembership</a>	01359240363	Not Notified
Gtt	<a href="mailto:owen.maguire@gtt.net">owen.maguire@gtt.net</a>	02807380028	Not Notified
Interoute	<a href="mailto:interoute.enquiries@plancast.co.uk">interoute.enquiries@plancast.co.uk</a>	02070259000	Not Notified
KPN (c/-Instalcom)	<a href="mailto:kpn.plantenquiries@instalcom.co.uk">kpn.plantenquiries@instalcom.co.uk</a>	n/a	Not Notified
Level 3 Communications UK Ltd (C/-Instalcom)	<a href="mailto:plantenquiries@instalcom.co.uk">plantenquiries@instalcom.co.uk</a>	02087314613	Not Notified
Mobile Broadband Network Limited	<a href="mailto:mbnl.plant.enquiries@turntown.com">mbnl.plant.enquiries@turntown.com</a>	01212 621 100	Not Notified
Tata (c/-McNicholas)	<a href="mailto:plantenquiries@mcnicholas.co.uk">plantenquiries@mcnicholas.co.uk</a>	03300558469	Not Notified
Utility assets Ltd	<a href="mailto:assetrecords@utilityassets.co.uk">assetrecords@utilityassets.co.uk</a>		Not Notified
Verizon Business	<a href="mailto:osp-team@uk.verizonbusiness.com">osp-team@uk.verizonbusiness.com</a>	01293611736	Not Notified
Virgin Media	<a href="http://www.digdat.co.uk">http://www.digdat.co.uk</a>	08708883116	Not Notified
Vodafone	<a href="mailto:osm.enquiries@atkinsglobal.com">osm.enquiries@atkinsglobal.com</a>	01454662881	Not Notified
Vtesse Networks	<a href="https://plant.interoute.com/plant-enquiries/">https://plant.interoute.com/plant-enquiries/</a>	01992532100	Not Notified
Wales and The West Utilities	<a href="http://www.wutilities.co.uk/login.aspx">www.wutilities.co.uk/login.aspx</a>	02920278912	Not Notified

#### Disclaimer

Please refer to LinesearchbeforeUdig's Terms of Use for full terms of use available at [www.linesearchbeforeudig.co.uk](http://www.linesearchbeforeudig.co.uk)

The results of this Enquiry are personal to the Enquirer and shall not be shared with or relied upon by any other party. The asset information on which the Enquiry results are based has been provided by LSBUD Members, therefore LinesearchbeforeUdig will provide no guarantee that such information is accurate or reliable nor does it monitor such asset information for accuracy and reliability going forward. There may also be asset owners which do not participate in the enquiry service operated by LinesearchbeforeUdig, including but not exclusively those set out above. Therefore, LinesearchbeforeUdig cannot make any representation or give any guarantee or warranty as to the completeness of the information contained in the enquiry results or accept any responsibility for the accuracy of the mapping images used. LinesearchbeforeUdig and its employees, agents and consultants accept no liability (save that nothing in this Enquiry Confirmation excludes or limits our liability for death or personal injury arising from our negligence, or our fraud or fraudulent misrepresentation, or any other liability that cannot be excluded or limited by English law) arising in respect thereof or in any other way for errors or omissions including responsibility to any person by reason of negligence.



Warning: PDF designed for colour print only with no page scaling.



**Contact Us**  
**Mapping Enquiries:**  
 All areas 0121 623 9780  
**General Enquiries:**  
 All areas 0800 096 3080

Date Requested: 12/01/2018  
 Job Reference: 11990220  
 Site Location: 314622 194180  
 Requested by:  
 Mrs Trudi Phillips  
 Your Scheme/Reference:  
 Nant Cylla Gabian Baskets


Link Box	Overhead Line	Underground Cable	SURF Telecoms	Pilot Cables
●	○ PL	---	S S	P P
○	○ Service	---	PME Earth	○ Pole Mounted Transformer
○	○ LV (11kV)	---	—E— Underground Earth	□ Ground Mounted Transformer
○	○ HV (33kV)	---		
○	○ HV (66kV)	---		
○	○ HV (132kV)	---		
— — —				

**IMPORTANT NOTICES**

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the Western Power Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

**Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA**  
**0800 6783 105**

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: EL27318X, 100024877 and 100021807.  
 WPD Copyright: This copy has been made by or with the authority of Western Power Distribution (WPD) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner

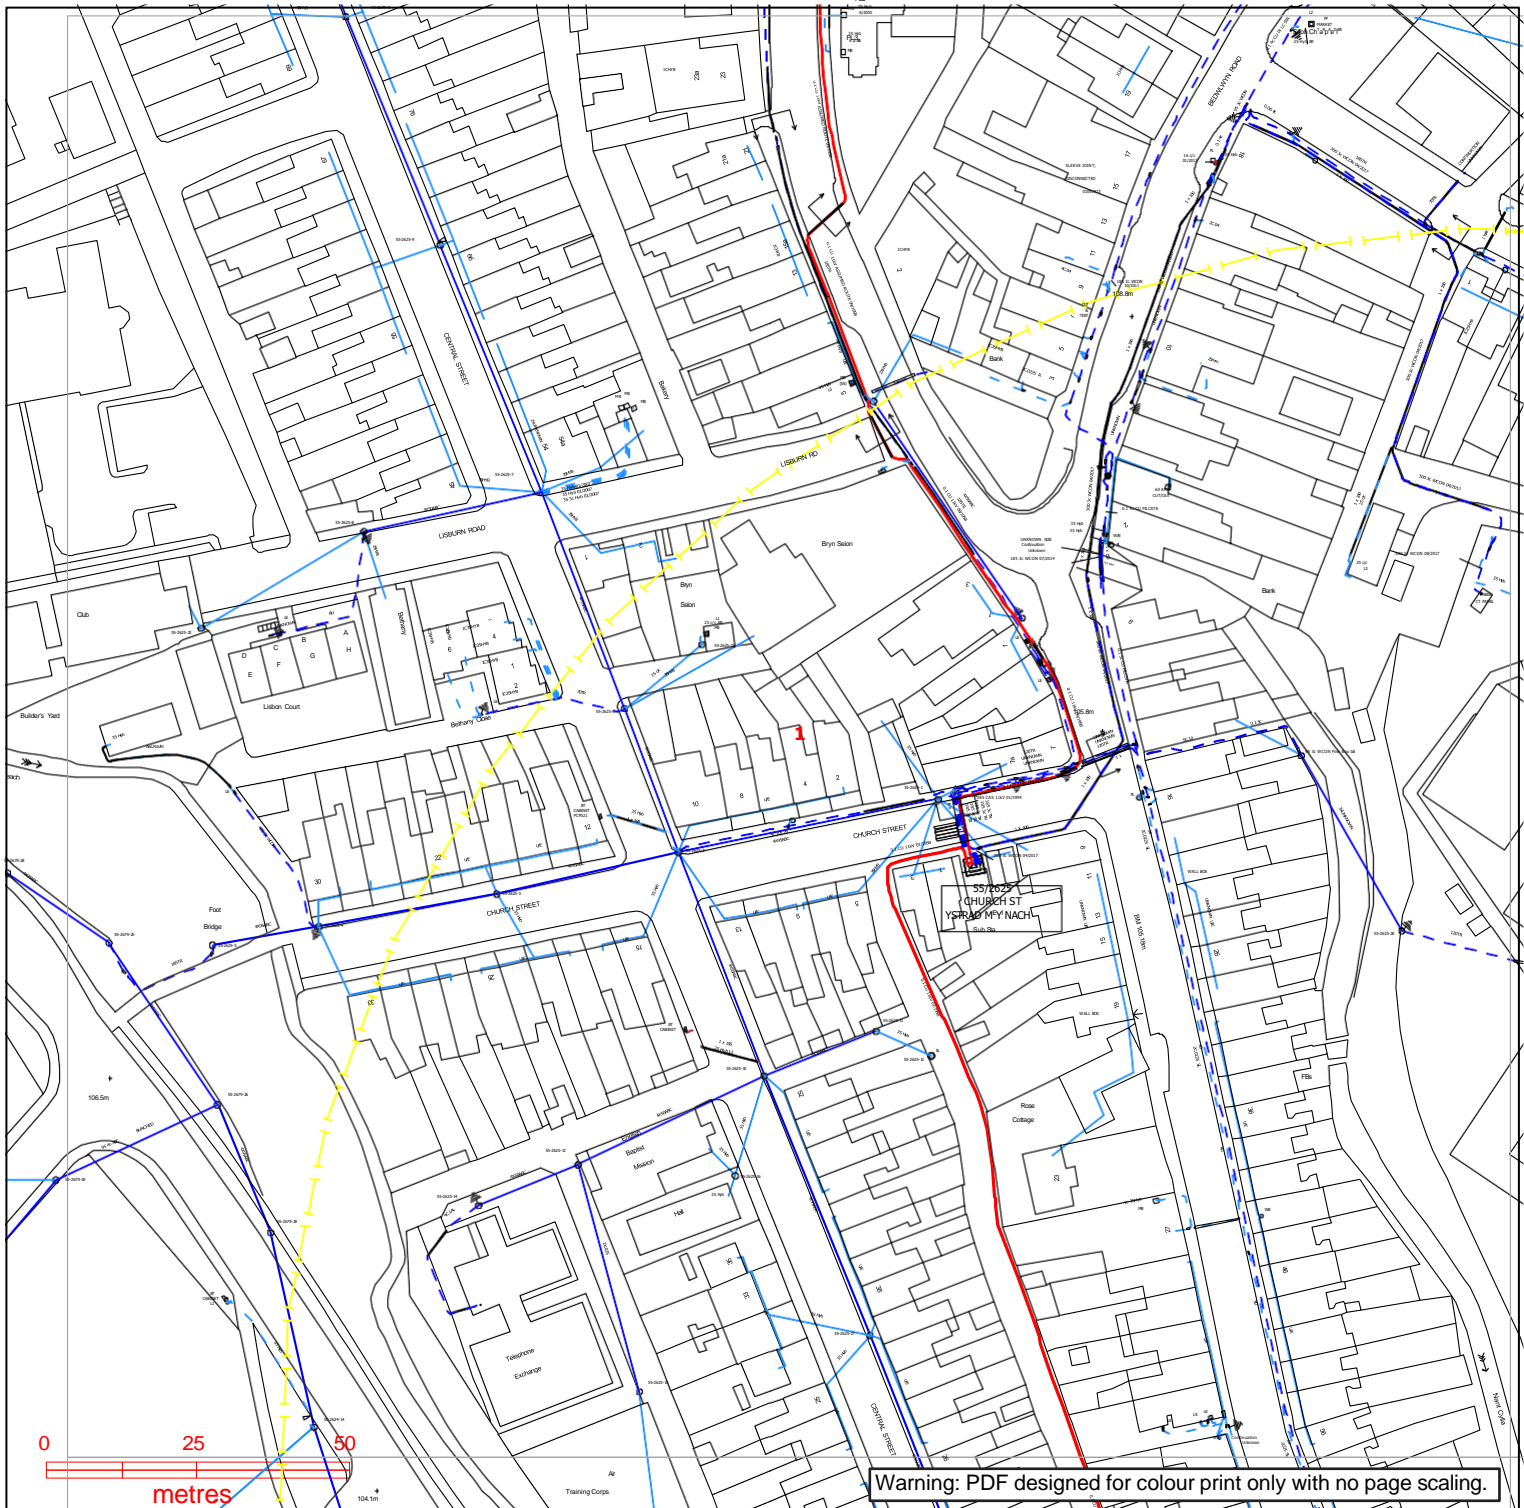

**WESTERN POWER DISTRIBUTION**  
*Serving the Midlands, South West and Wales*

**Contact Us**  
**Mapping Enquiries:**  
 All areas 0121 623 9780  
**General Enquiries:**  
 All areas 0800 096 3080

Date Requested: 12/01/2018  
 Job Reference: 11990220  
 Site Location: 314622 194180  
 Requested by:  
 Mrs Trudi Phillips  
 Your Scheme/Reference:  
 Nant Cylla Gabian Baskets

Exact Scales:  
 1:1250 Area or Circle dig site  
 1:500 Line dig site


Link Box	Overhead Line	Underground Cable	SURF Telecoms	Pilot Cables
●	○ PL	— — — — —	— S — S —	— P — P —
●	○ Service	— — — — —	— — — — —	○ Pole Mounted Transformer
●	○ LV	— — — — —	— — — — —	□ Ground Mounted Transformer
●	○ HV (11kV)	— — — — —	— — — — —	
●	○ HV (33kV)	— — — — —	— — — — —	
●	○ HV (66kV)	— — — — —	— — — — —	
●	○ HV (132kV)	— — — — —	— — — — —	
— — — — —			— — — — —	
			— — — — —	
			— — — — —	

**IMPORTANT NOTICES**

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the Western Power Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

**Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA**  
**0800 6783 105**

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: EL27318X, 100024877 and 100021807.  
 WPD Copyright: This copy has been made by or with the authority of Western Power Distribution (WPD) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner

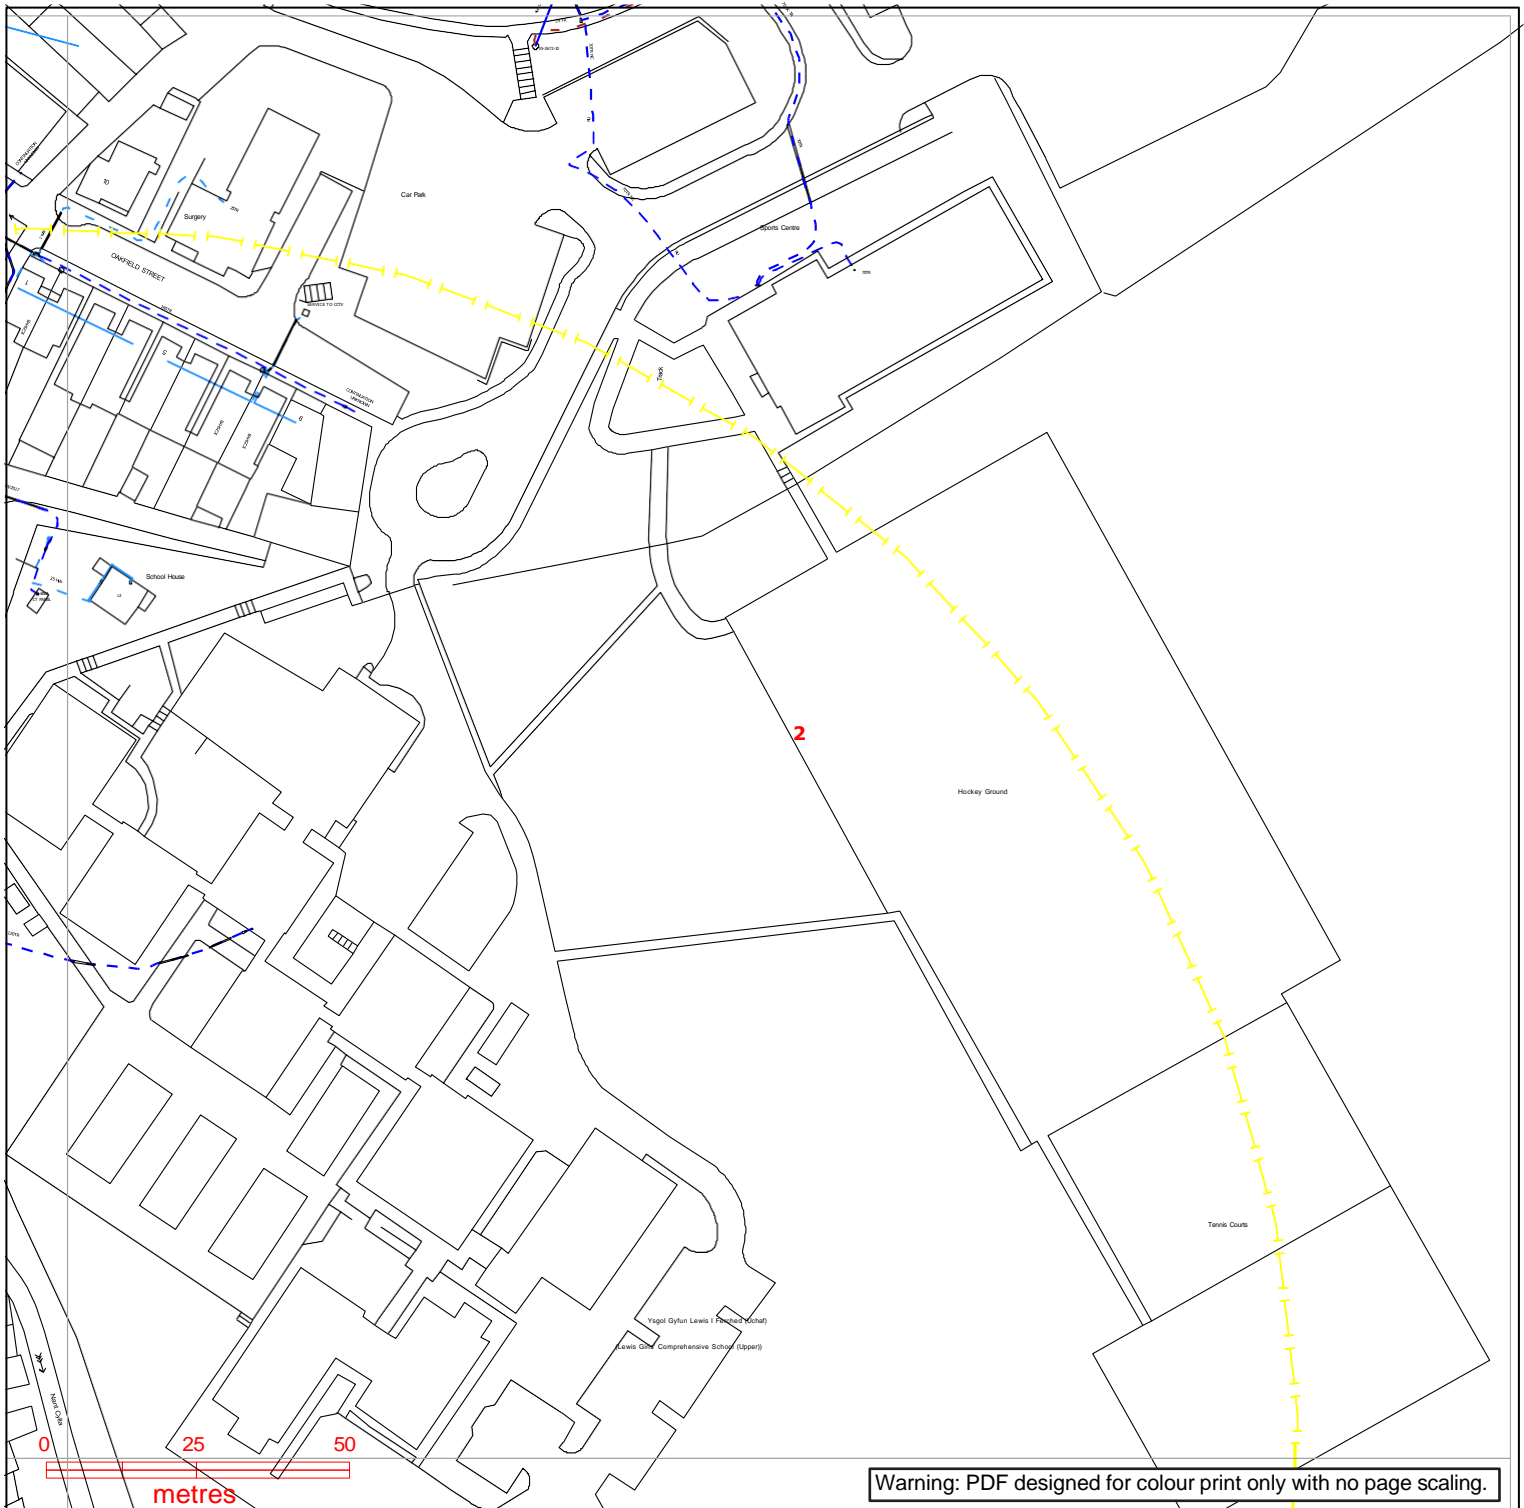

Warning: PDF designed for colour print only with no page scaling.



**Contact Us**  
**Mapping Enquiries:**  
 All areas 0121 623 9780  
**General Enquiries:**  
 All areas 0800 096 3080

Date Requested: 12/01/2018  
 Job Reference: 11990220  
 Site Location: 314622 194180  
 Requested by:  
 Mrs Trudi Phillips  
 Your Scheme/Reference:  
 Nant Cylla Gabian Baskets

Exact Scales:  
 1:1250 Area or Circle dig site  
 1:500 Line dig site


<b>Link Box</b> ●	<b>Overhead Line</b> ○ ○ PL ○ ○ Service ○ ○ LV ○ ○ HV (11kV) ○ ○ HV (33kV) ○ ○ HV (66kV) ○ ○ HV (132kV)	<b>Underground Cable</b> - - - PL - - - Service - - - LV - - - HV (11kV) - - - HV (33kV) - - - HV (66kV) - - - HV (132kV)	<b>SURF Telecoms</b> - - - S - - - S PME Earth Underground Earth	<b>Pilot Cables</b> P - - - P ○ Pole Mounted Transformer □ Ground Mounted Transformer
----------------------	--	--	---	--

**IMPORTANT NOTICES**

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the Western Power Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

**Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA**  
**0800 6783 105**

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: EL27318X, 100024877 and 100021807.  
 WPD Copyright: This copy has been made by or with the authority of Western Power Distribution (WPD) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner

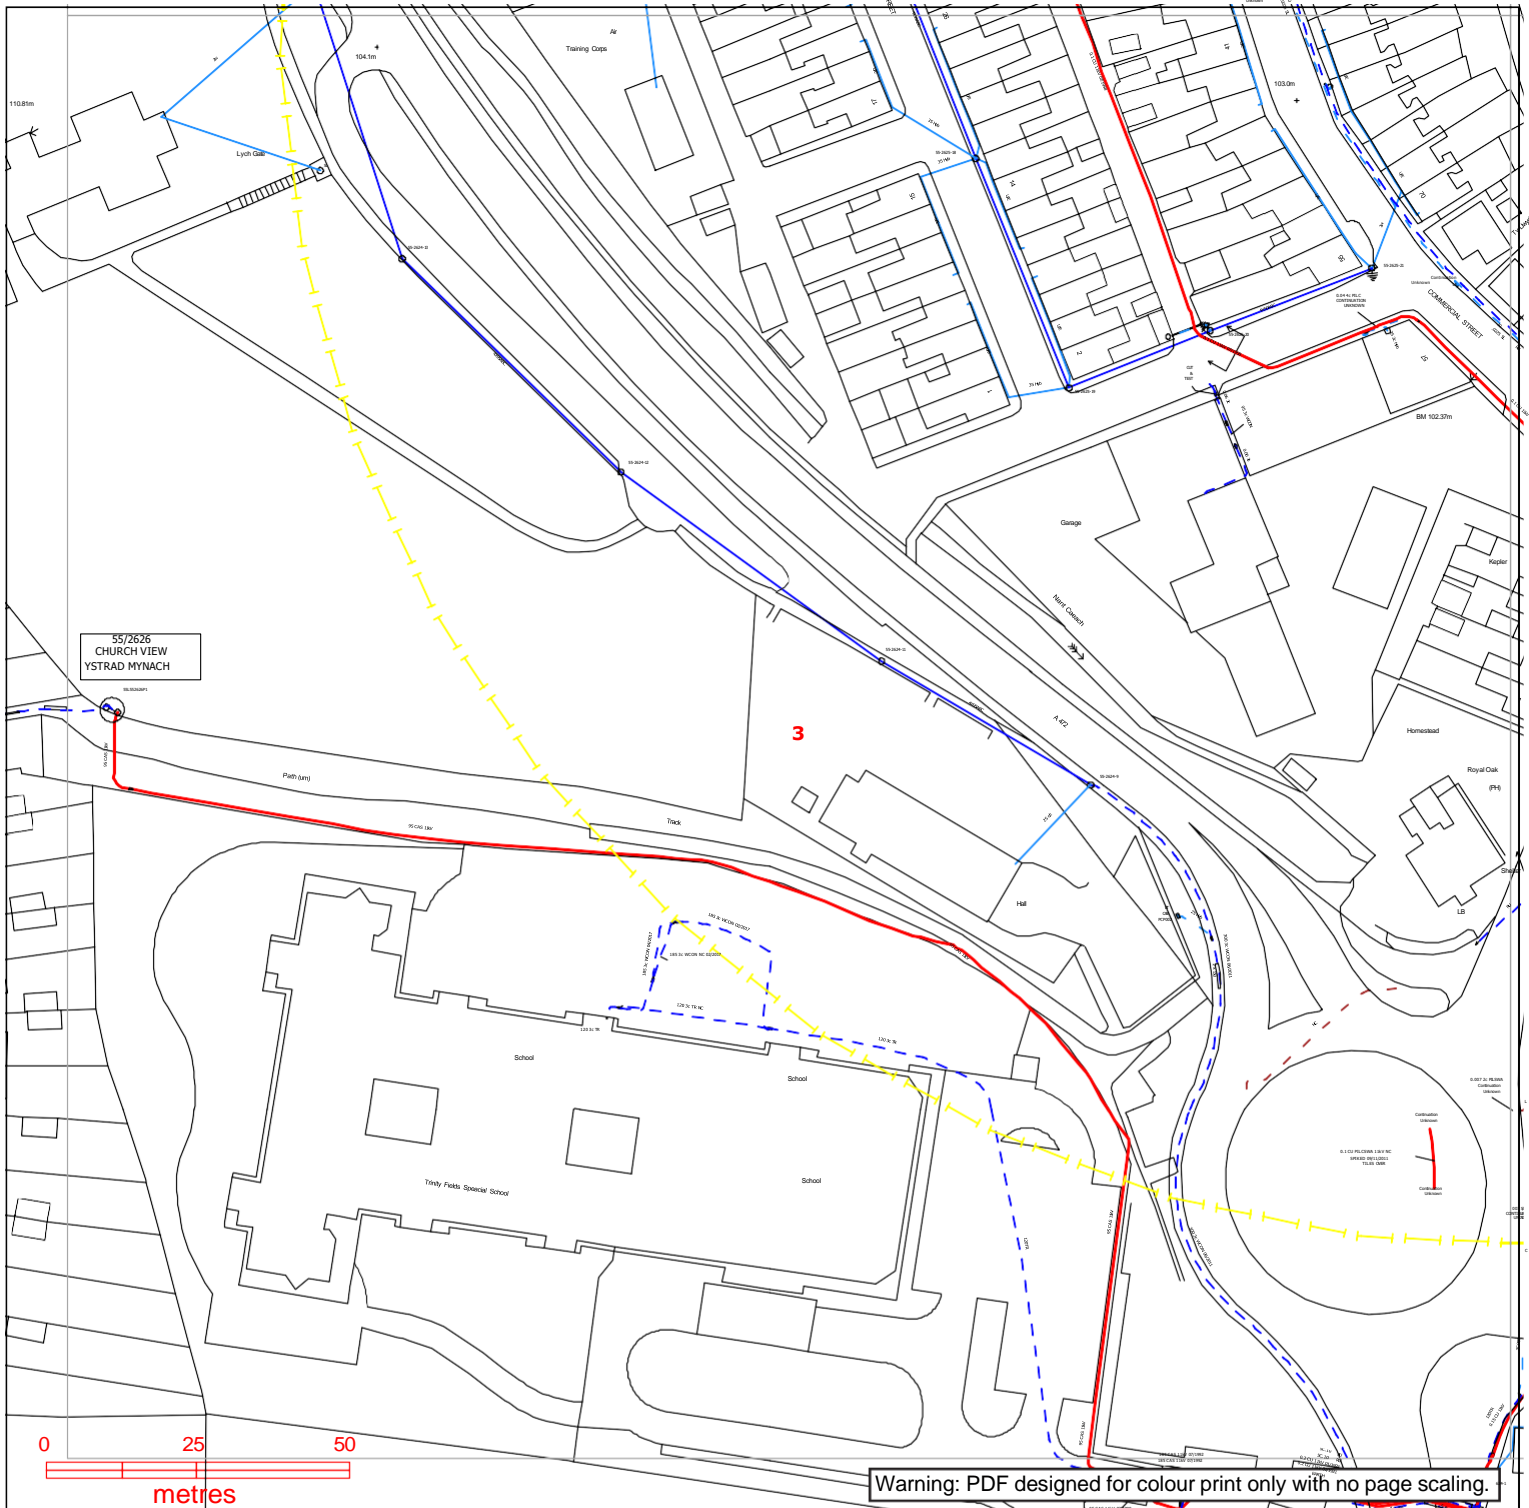

**WESTERN POWER DISTRIBUTION**  
*Serving the Midlands, South West and Wales*

**Contact Us**  
**Mapping Enquiries:**  
 All areas 0121 623 9780  
**General Enquiries:**  
 All areas 0800 096 3080

Date Requested: 12/01/2018  
 Job Reference: 11990220  
 Site Location: 314622 194180  
 Requested by:  
 Mrs Trudi Phillips  
 Your Scheme/Reference:  
 Nant Cylla Gabian Baskets

Exact Scales:  
 1:1250 Area or Circle dig site  
 1:500 Line dig site

Link Box	Overhead Line	Underground Cable	SURF Telecoms	Pilot Cables
●	○—○ PL	---	S—S	P—P
●	○—○ Service	---	PME Earth	○ Pole Mounted Transformer
●	○—○ LV	---	—E— Underground Earth	□ Ground Mounted Transformer
●	○—○ HV (11kV)	---		
●	○—○ HV (33kV)	---		
●	○—○ HV (66kV)	---		
●	○—○ HV (132kV)	---		


**IMPORTANT NOTICES**

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the Western Power Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.


**Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA**  
**0800 6783 105**

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: EL27318X, 100024877 and 100021807.  
 WPD Copyright: This copy has been made by or with the authority of Western Power Distribution (WPD) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner



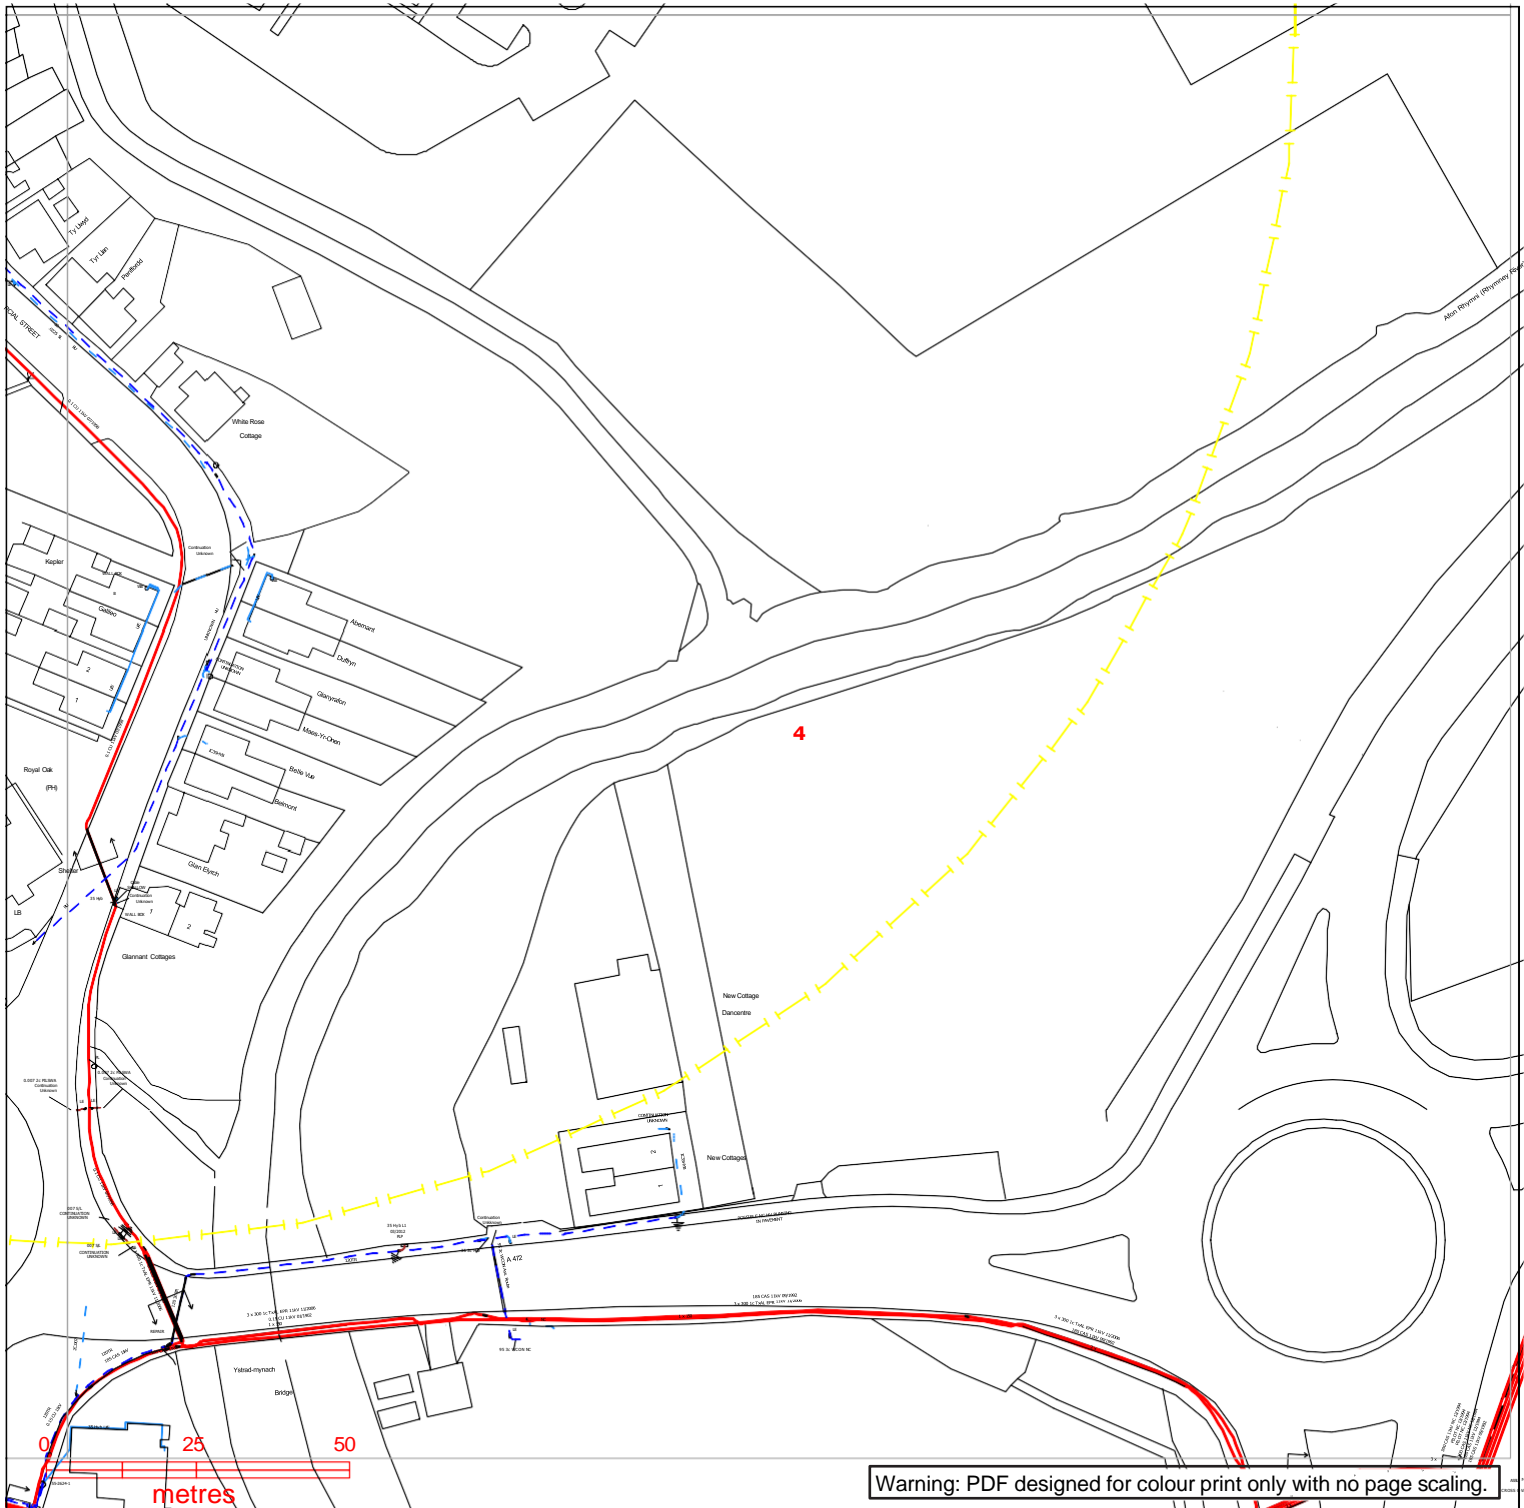

Warning: PDF designed for colour print only with no page scaling.



**Contact Us**  
**Mapping Enquiries:**  
 All areas 0121 623 9780  
**General Enquiries:**  
 All areas 0800 096 3080

Date Requested: 12/01/2018  
 Job Reference: 11990220  
 Site Location: 314622 194180  
 Requested by:  
 Mrs Trudi Phillips  
 Your Scheme/Reference:  
 Nant Cylla Gabian Baskets

Exact Scales:  
 1:1250 Area or Circle dig site  
 1:500 Line dig site

<b>Link Box</b> ●	<b>Overhead Line</b> ○ ○ PL ○ ○ Service ○ ○ LV ○ ○ HV (11kV) ○ ○ HV (33kV) ○ ○ HV (66kV) ○ ○ HV (132kV)	<b>Underground Cable</b> - - - PL - - - Service - - - LV - - - HV (11kV) - - - HV (33kV) - - - HV (66kV) - - - HV (132kV)	<b>SURF Telecoms</b> - - - S - - - S PME Earth Underground Earth	<b>Pilot Cables</b> P - - - P ○ Pole Mounted Transformer □ Ground Mounted Transformer
----------------------	--	--	---	--

**IMPORTANT NOTICES**

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the Western Power Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.


**Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA**  
**0800 6783 105**











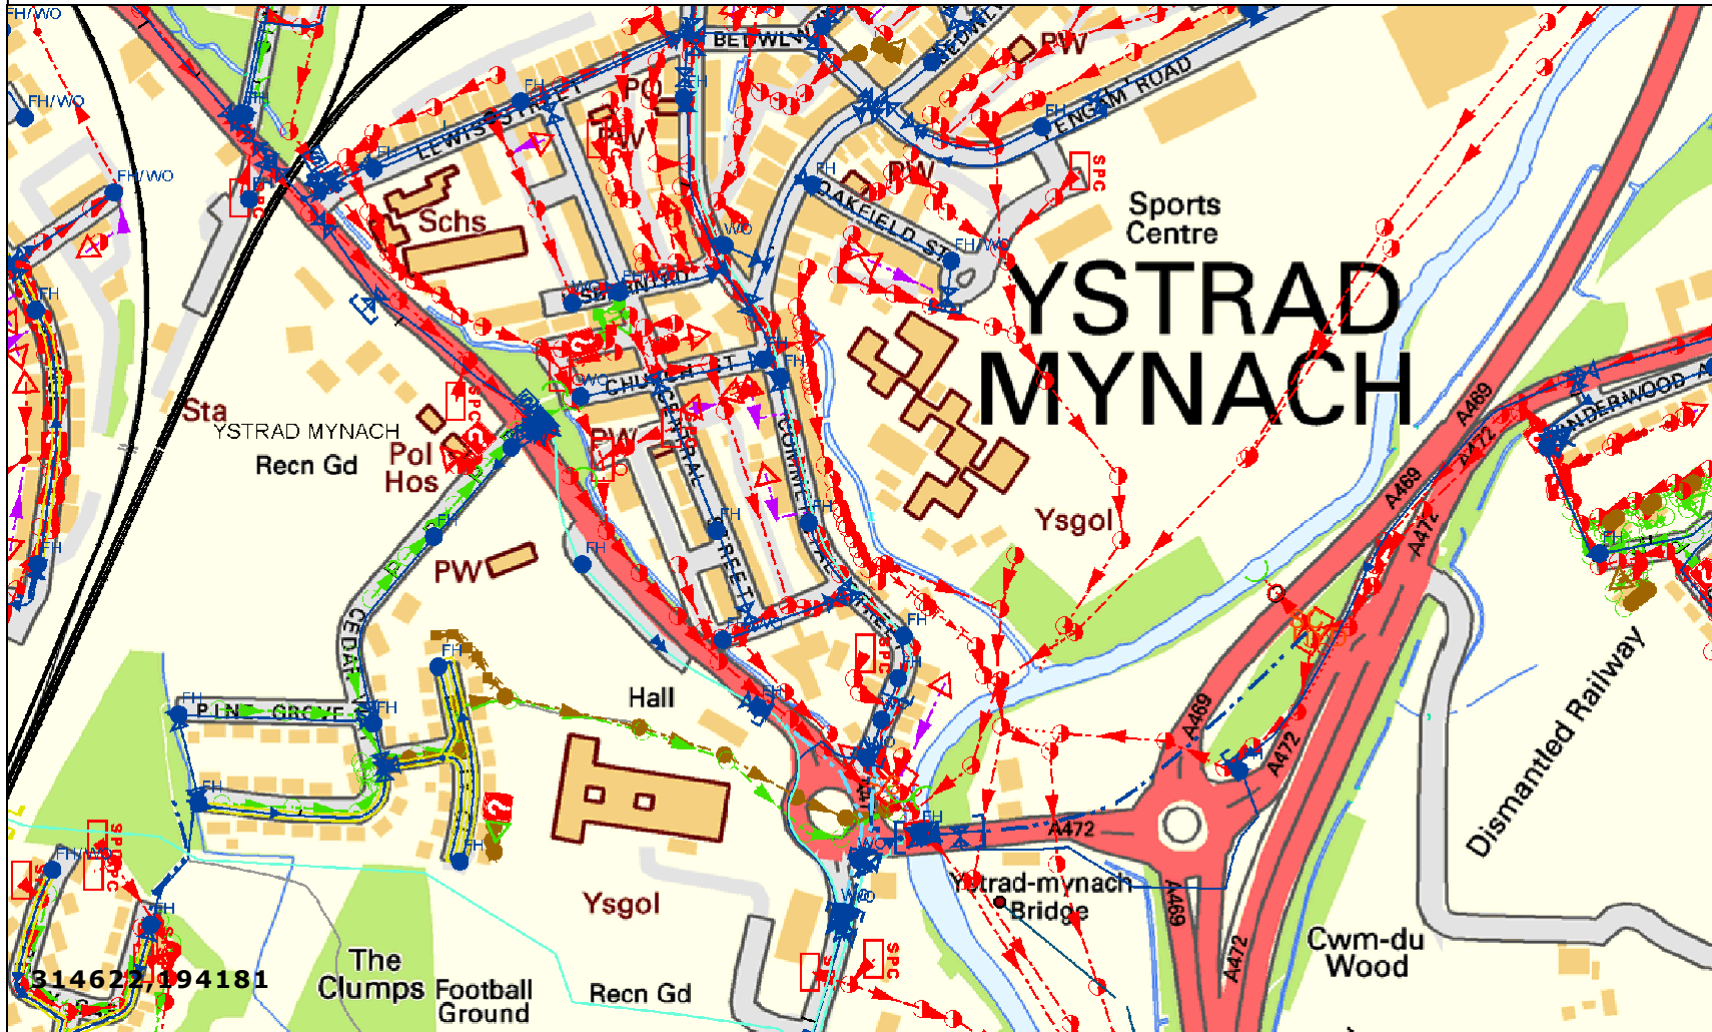














Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: EL27318X, 100024877 and 100021807.  
 WPD Copyright: This copy has been made by or with the authority of Western Power Distribution (WPD) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner

Nant Cylla Gabian Baskets



Scale: 1:5000



- LEGEND**
- Clean Water**
-  Sluice Val
  -  Air Val, SINGLE
  -  Tap
  -  Pressure Reducing Valve
  -  Meter
  -  BULK Meter
  -  FH
  -  Cap
  -  Existing Main
  -  NON COMPANY
- Sewerage External**
-  Foul
  -  Surface Water
  -  Combined
  -  Rising Main
  -  Private
  -  Treatment Works
  -  Pumping Station
  -  Special Purpose
  -  Unknown End
  -  Change, Combined Overflow
  -  Outfall, FOUL
  -  Lamp Hole, Foul
  -  Private Sewer Transfer
  -  Lateral Drain
  -  Inspection Chamber


Dwr Cymru Cyfyngedig ('the Company') gives this information as to the position of its underground apparatus by way of general guidance only and on the strict understanding that it is based on the best information available and no warranty as to its correctness is relied upon in the event of excavations or other works made in the vicinity of the Company's apparatus and any onus of locating the apparatus before carrying out any excavations rests entirely on you. The information which is supplied hereby by the Company, is done so in accordance with statutory requirements of sections 198 and 199 of the Water Industry Act 1991 based upon the best information available and in particular, but without prejudice to the generality of the foregoing, it should be noted that the records that are available to the Company may not disclose the existence of a drain sewer or disposal main laid before 1 September 1989, or if they do, the particulars thereof including their position underground may not be accurate. It must be understood that the furnishing of this information is entirely without prejudice to the provision of the New Roads and Street Works Act 1991 and the Company's right to be compensated for any damage to its apparatus.

**EXACT LOCATION OF ALL APPARATUS TO BE DETERMINED ON SITE**

Reproduced from the Ordnance Survey's maps with the permission of the Controller of Her Majesty's Stationary Office. Crown Copyright. Licence No: WU298565.

Whilst every reasonable effort has been taken to correctly record the pipe material of DCWW assets, there is a possibility that in some cases pipe material (other than Asbestos Cement or Pitch Fibre) may be found to be asbestos cement (AC) or Pitch Fibre (PF). It is therefore advisable that the possible presence of AC or PF pipes be anticipated and considered as part of any risk assessment prior to excavation.

Extreme caution. Major Accident Hazard Pipeline in Vicinity.  
**\*\*RISK OF DEATH OR SERIOUS INJURY\*\***  
 Prior to excavation starting you must contact the plant protection team on 02920 278912.  
 Extreme caution. Major Accident Hazard Pressurised Gas Plant in Vicinity.

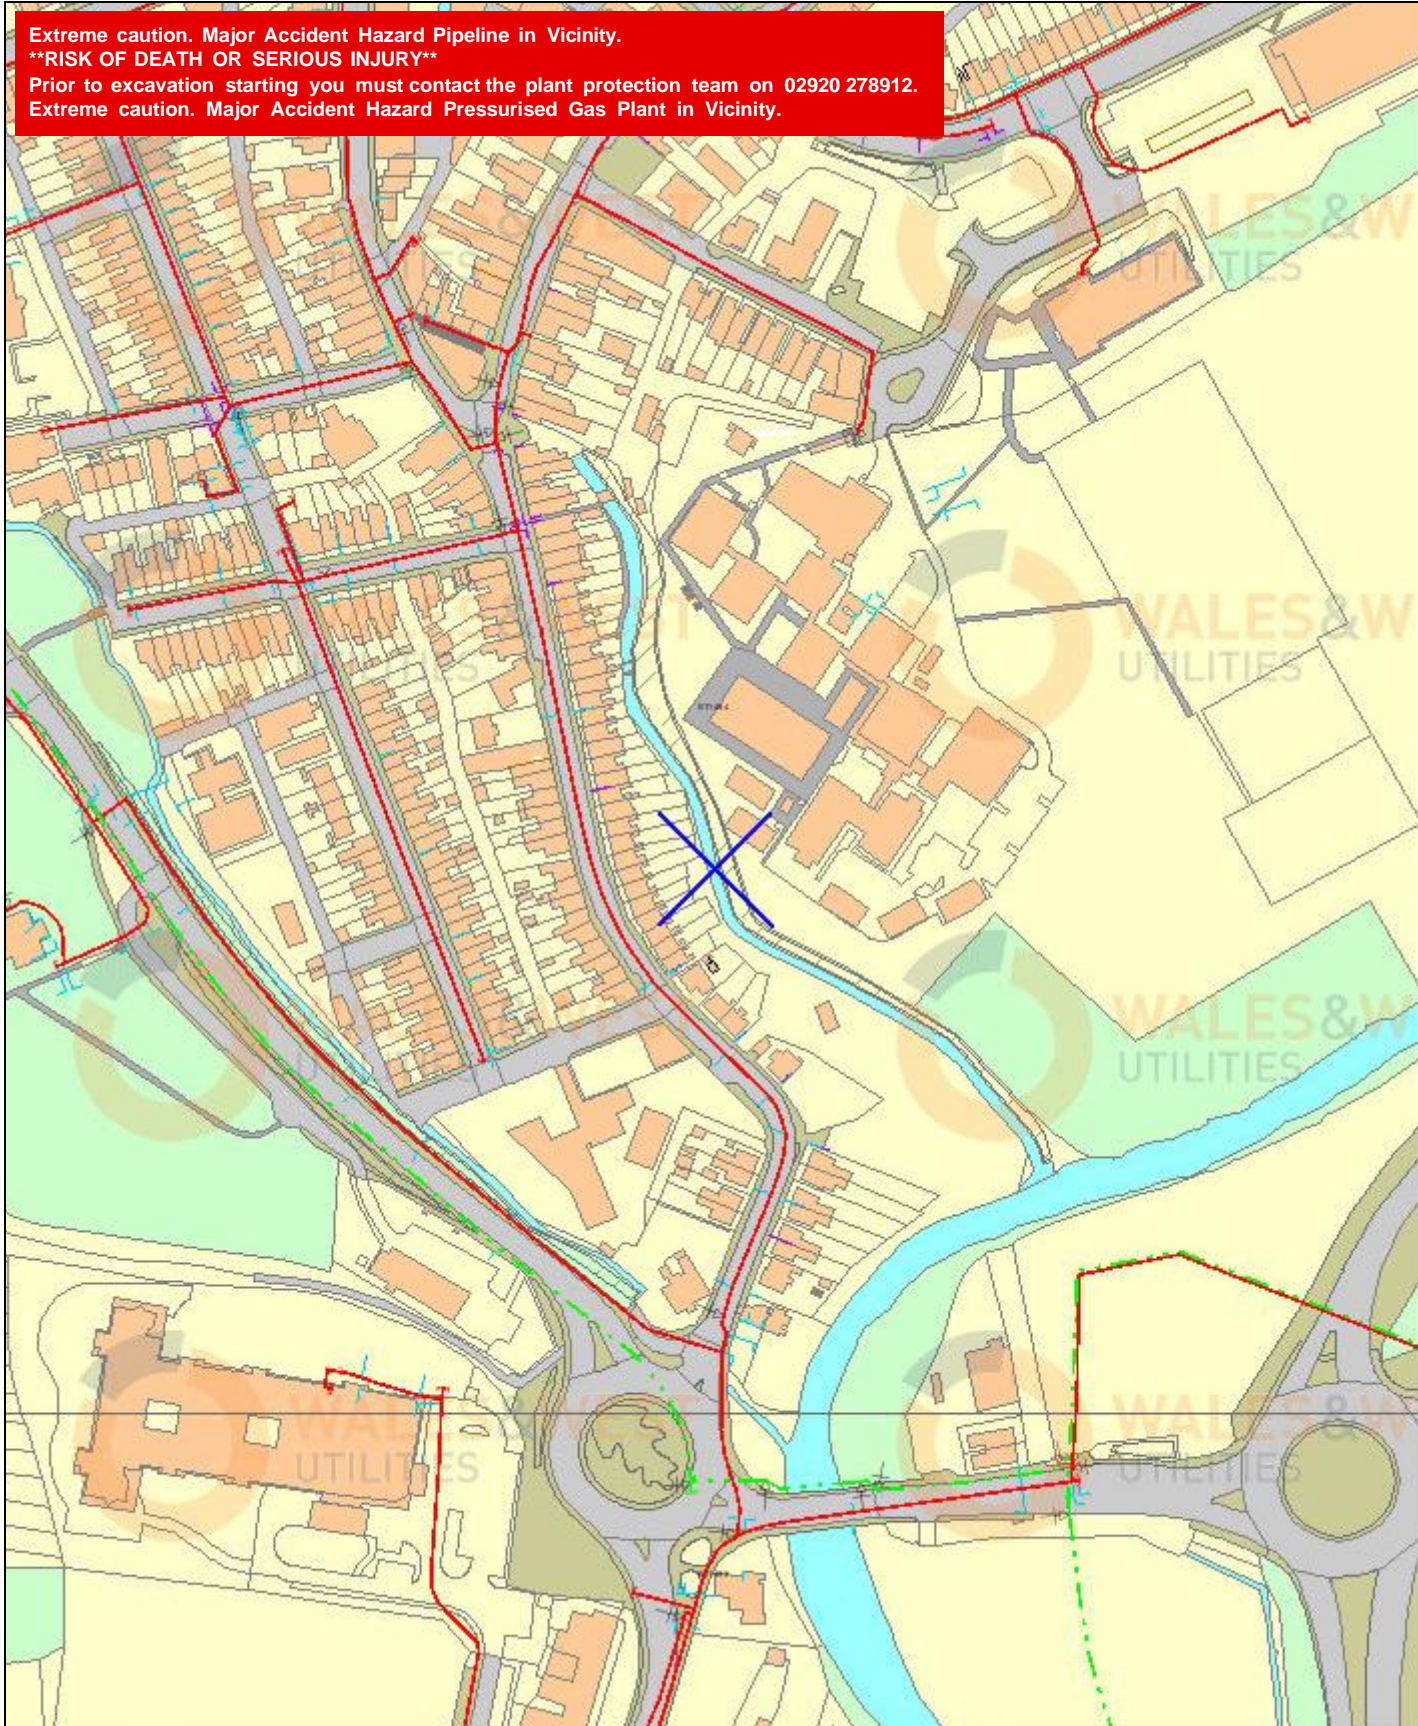

Scale 1 : 2500@A4

User ID phil1t@caerphilly.go

Date 12/01/2018

Grid Ref: Easting: 314622  
 Northing: 194181

TITLE : Nant Cylla Gabian Baskets

The plan shows those gas pipes owned by Wales & West Utilities (WU) in its role as a Licensed Gas Transporter (GT). The information shown on this plan is derived from historic information and may have involved re-surveying plans, and the accuracy of it can not be guaranteed. Service pipes, valves, syphons, stub connections, etc. may not be shown but their presence should be anticipated. No warranties are therefore given in respect of it. WU its employees and contractors do not accept any liability for any inaccuracy or incompleteness in it.

You must use safe digging practices, in accordance with HSG47, to establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you or near gas apparatus. The information shown on this plan should not be used beyond 28 days from the date of issue of this plan as it is subject to updating.

The plan also provides indications of gas pipes owned by other GTs, or otherwise privately owned, which may be present in this area. This information is not information of WU and WU is unable to verify this information or to confirm whether it is accurate or complete. It is supplied voluntarily to assist the user in determining whether to make contact with other GTs or others. The user must obtain such information from the other GT or person concerned. WU, its employees and contractors do not accept any liability for this information or any inaccuracy or incompleteness in it.

- Low Pressure
- Medium Pressure
- Intermediate Pressure
- High Pressure
- Design Pipes
- Abandoned



Wales and West Utilities Ltd., Wales and West House, Spooner Close, Celtic Springs, Coedkernew, Newport, NP10 8FZ

Internal Use Only

© All Master Map data is reproduced by permission of Ordnance Survey on behalf of HMSO. © Crown copyright and database right 2018. All rights reserved. Ordnance Survey Licence number 0100044306.

